


S1a: Vertical services penetration

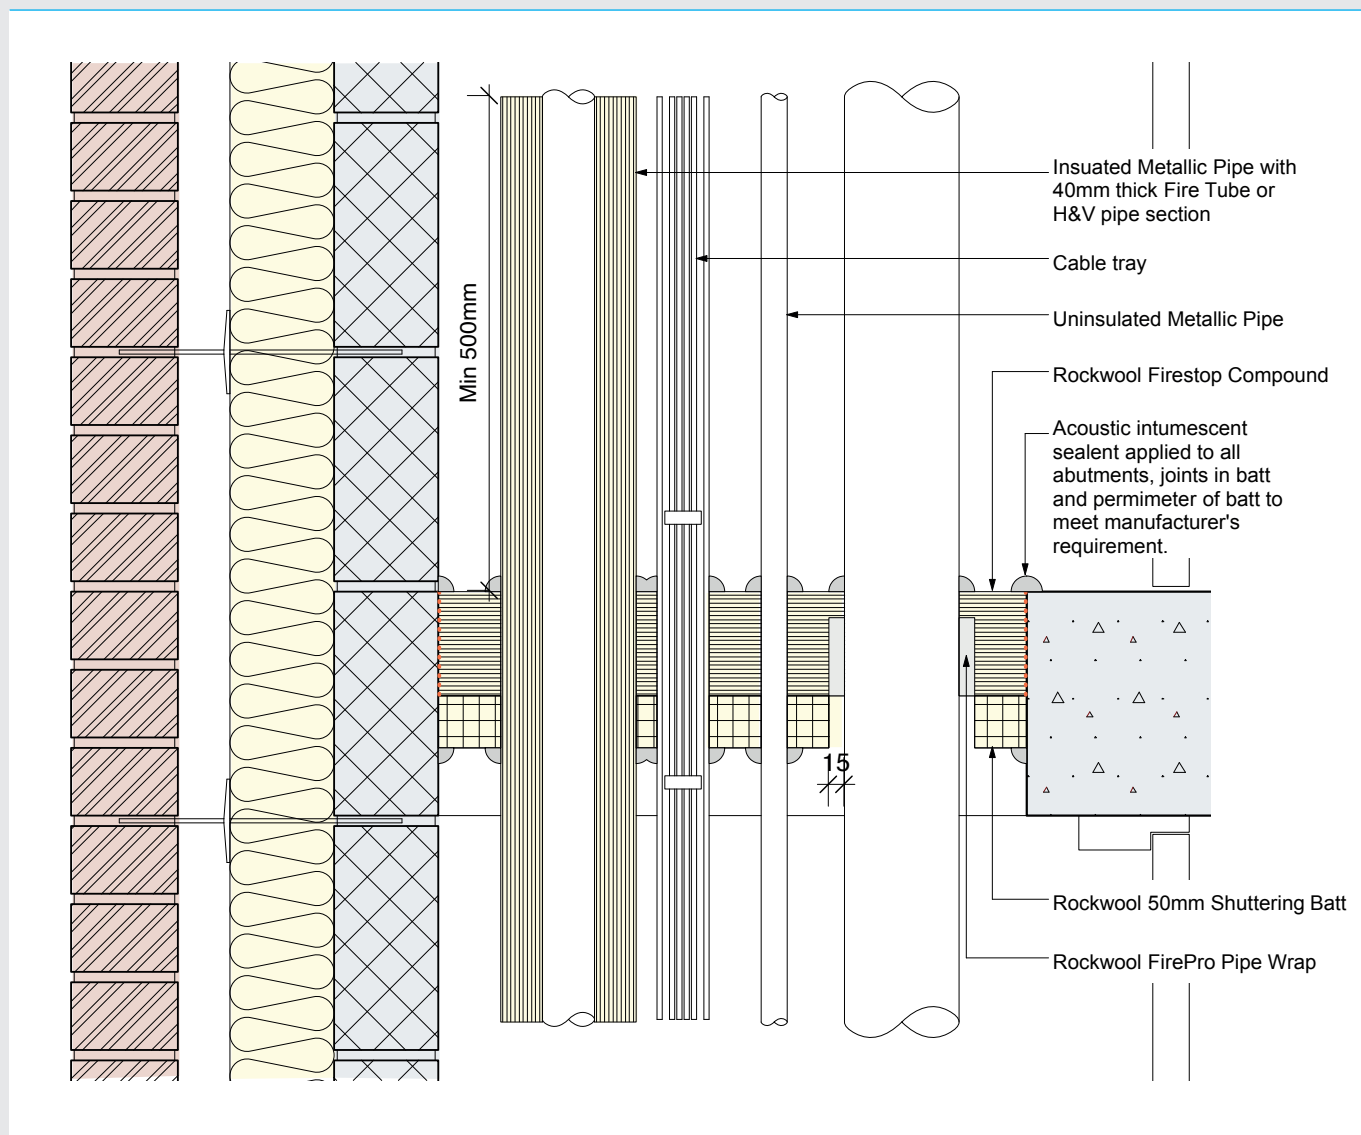

Requirements

- The service riser shuttering batt insulation must have all service penetrations, joints and abutments sealed to meet manufacturer's requirements.

Notes :

- Acoustic intumescent sealant applied to all abutments, joints and perimeter of batt insulation to meet manufacturer's requirements.